

UNITED WATER ARKANSAS

PWS ID# = 272

WELL #16

Radius of Assessment Area = 9500 ft

PSOCs in Assessment Area, No Septic Systems

▲ Intake (well/surface)  
PSOC Health Risk Code

☆ 1 - 2

△ 3 - 4

□ 5 - 6

⊕ 7 - 8

○ 9 - 10


— Road

— Railroad


— Stream

■ Lake or Pond

■ Assessment Area

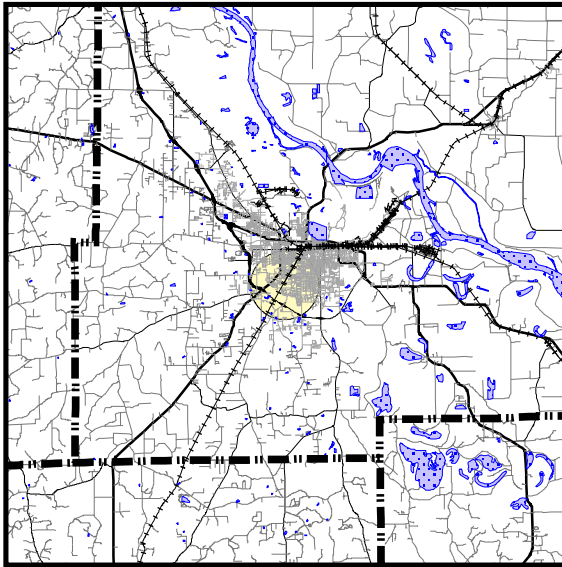

1000 0 1000 Feet

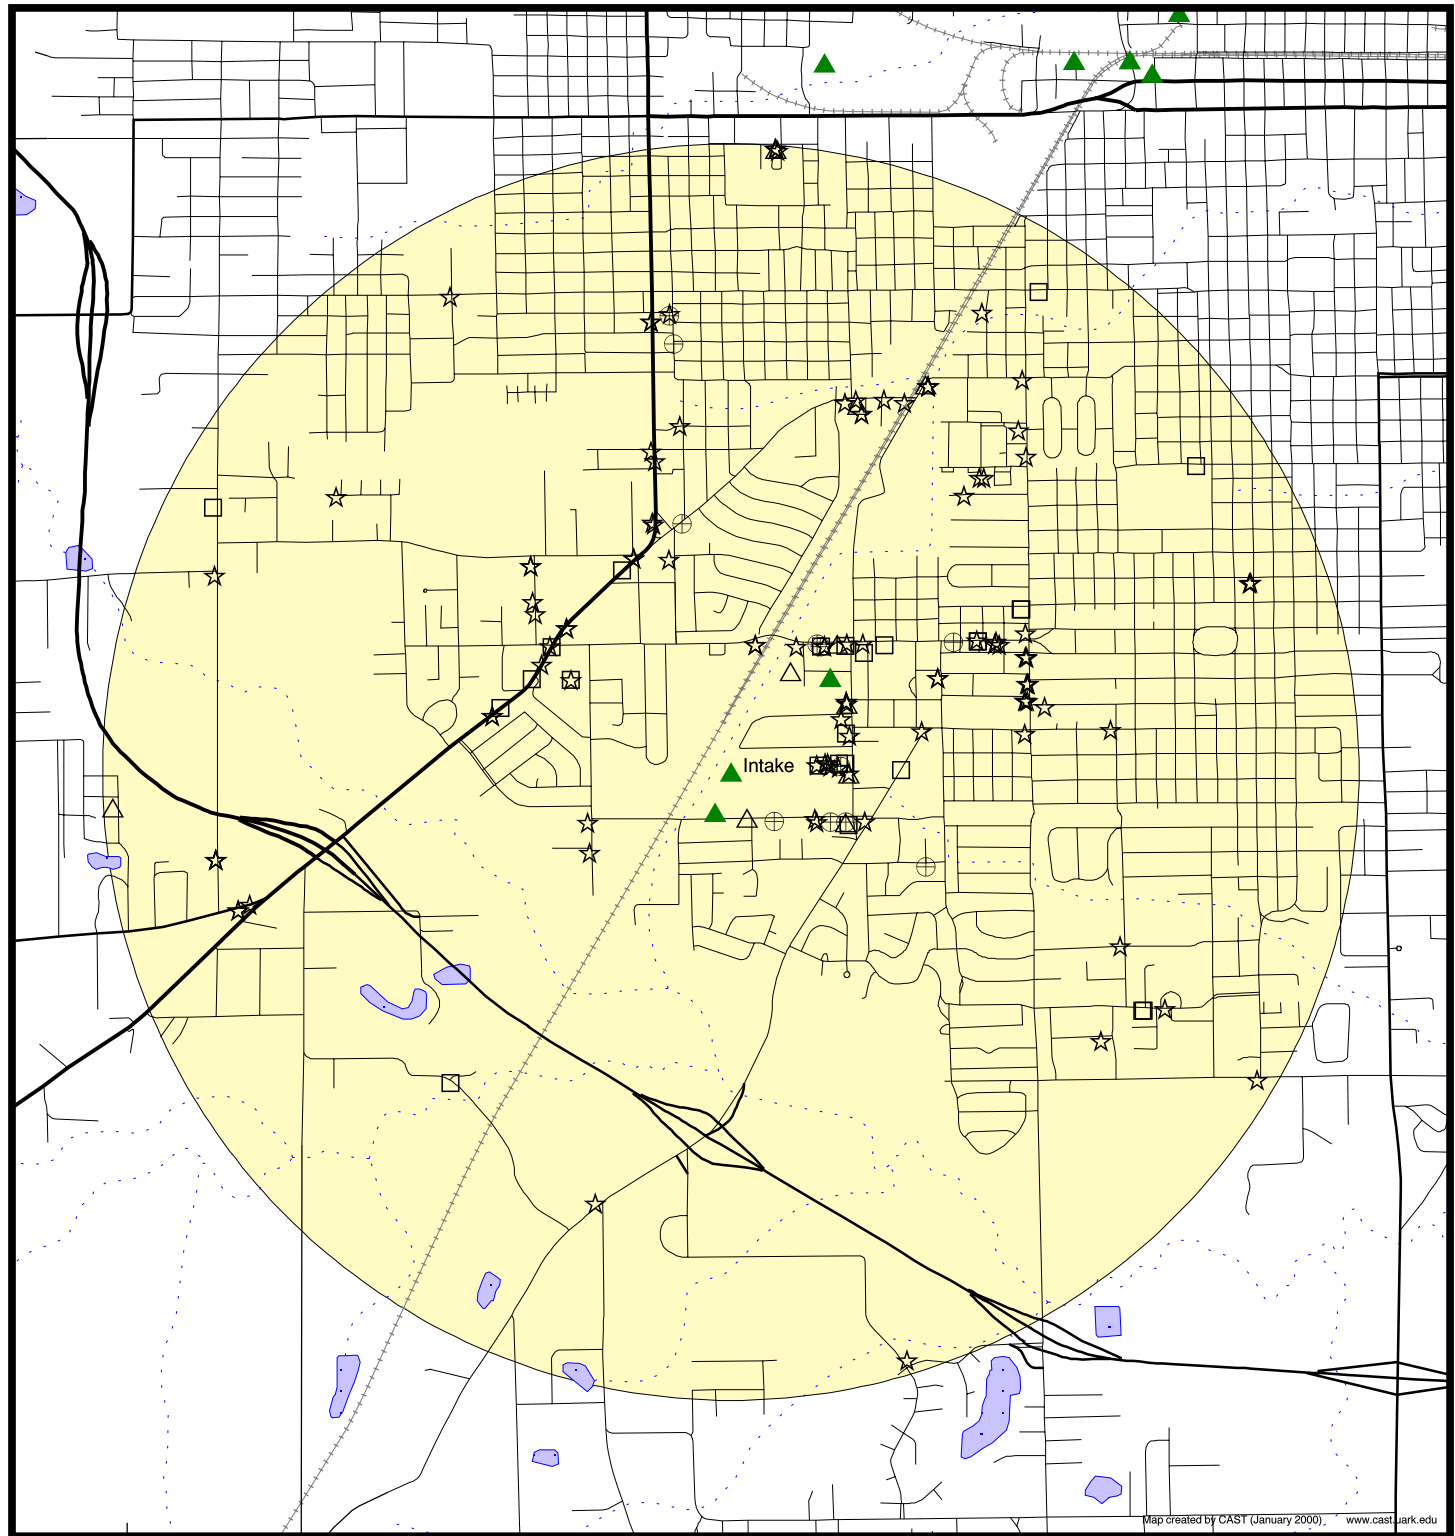

UNITED WATER ARKANSAS

PWS ID# = 272

WELL #16

Radius of Assessment Area = 9500 ft

All PSOCs in Assessment Area

▲ Intake (well/surface)  
PSOC Health Risk Code

☆ 1 - 2

△ 3 - 4

□ 5 - 6

⊕ 7 - 8

○ 9 - 10


— Road

— Railroad


— Stream

■ Lake or Pond

■ Assessment Area

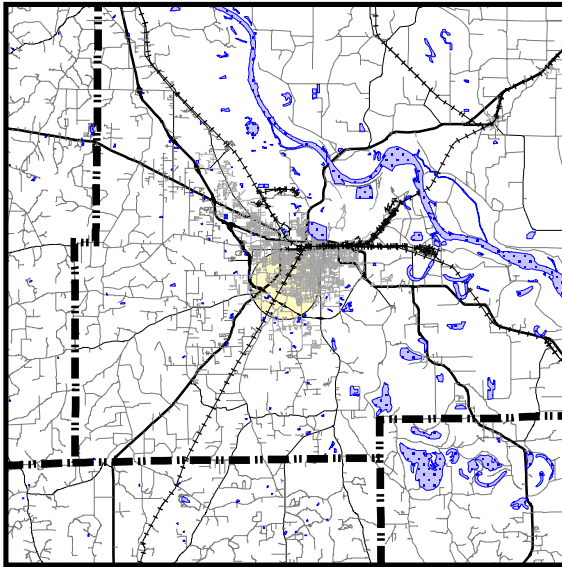

1000 0 1000 Feet

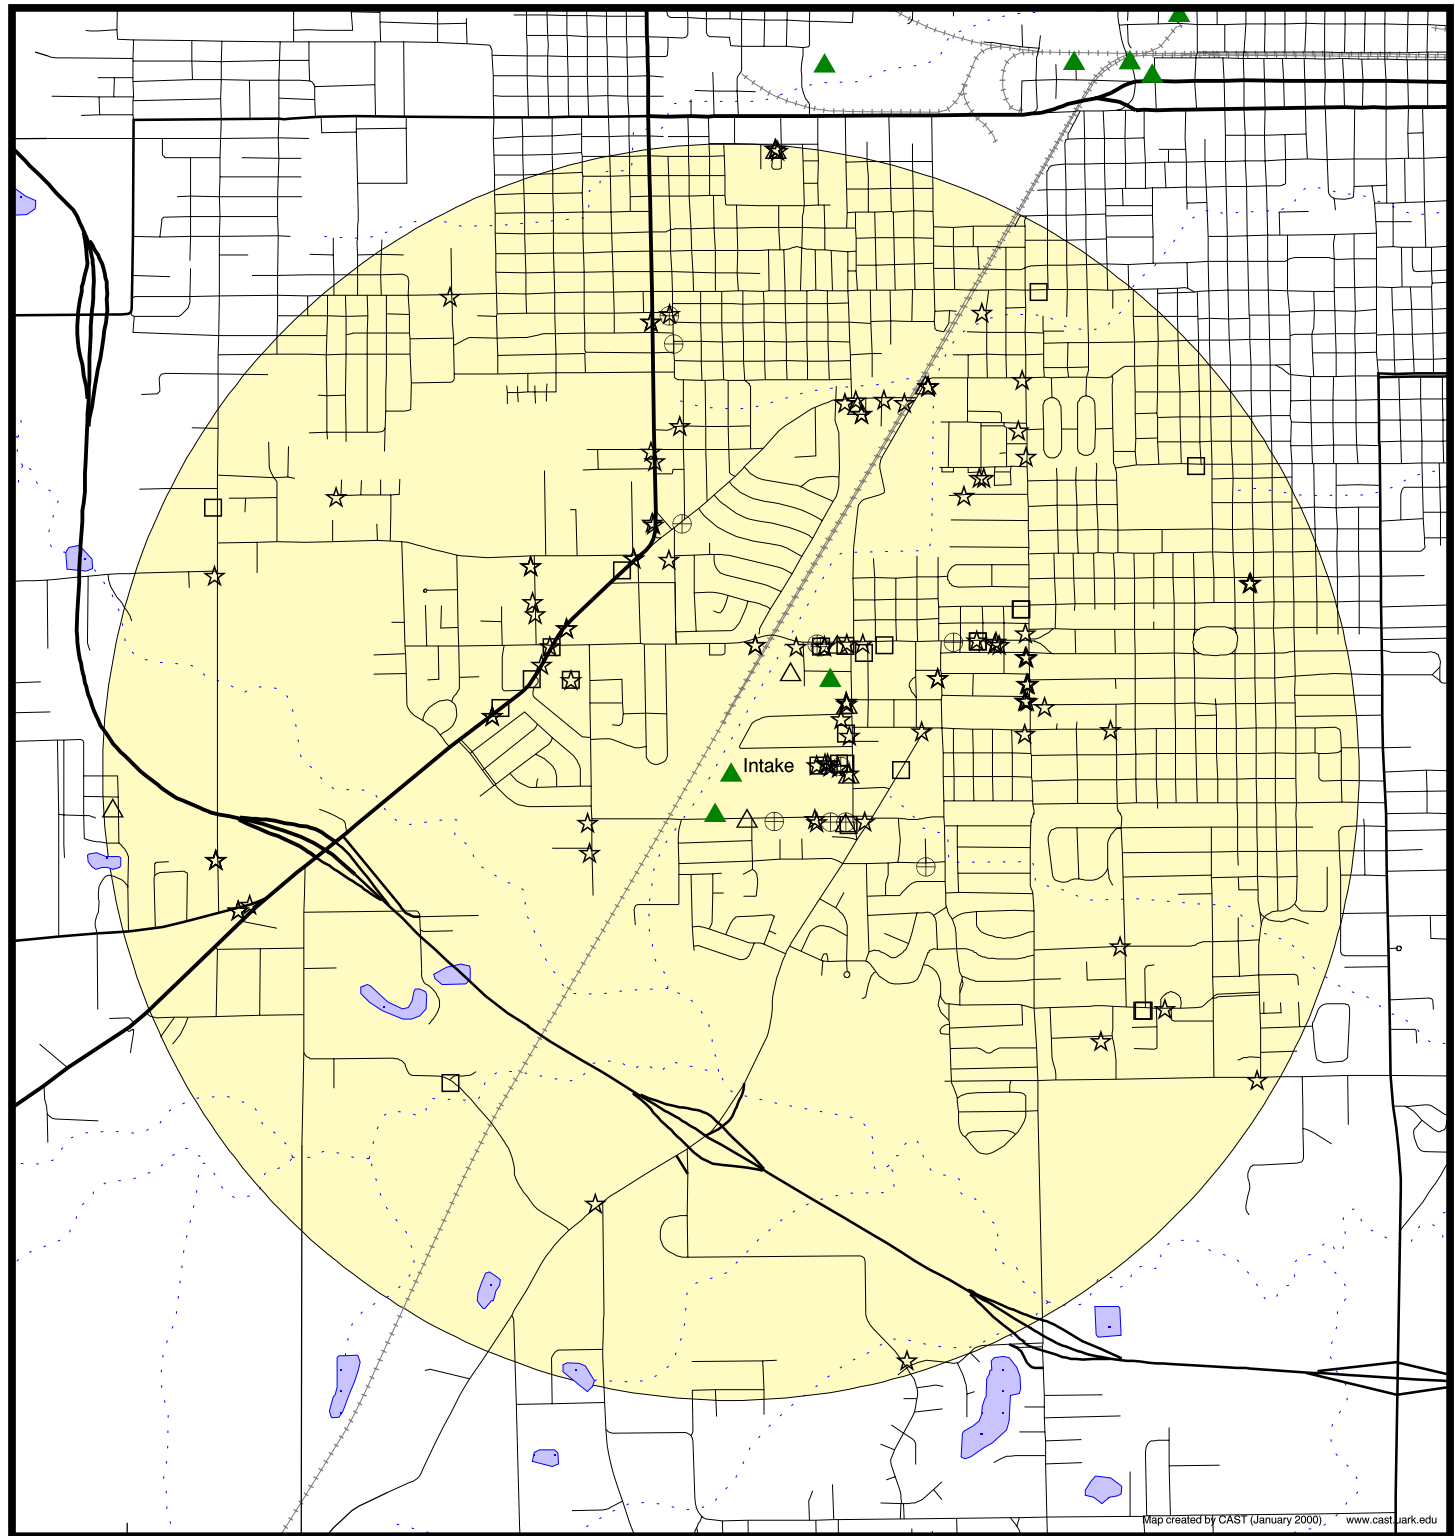

## WATER SYSTEM "PSOC"

&lt;1/3 of radius

&gt;1/3 and &lt;2/3 of radius

&gt;2/3 of radius

| Summary Report        |          | DISTZONE |    |    | Health Risk |
|-----------------------|----------|----------|----|----|-------------|
| WELL_ID               | GRND_HRC | 1        | 2  | 3  | Sub-Totals  |
| 272202                | 1        | 5        | 7  | 10 | 22          |
|                       | 2        | 20       | 39 | 20 | 79          |
|                       | 3        | 5        | 2  | 5  | 12          |
|                       | 4        | 1        | 1  |    | 2           |
|                       | 5        | 1        | 5  | 5  | 11          |
|                       | 6        | 10       | 8  | 4  | 22          |
|                       | 7        | 6        | 3  | 1  | 10          |
|                       | 8        | 9        | 8  | 14 | 31          |
| Dist. Zone Sub-Totals |          | 57       | 73 | 59 | 189         |